


Laying Out Your Backpanel Spacing


Use 6.35 mm (0.25 inch) mounting bolts to attach the I/O chassis to the enclosure backpanel.

Chassis Dimensions (Series B)

1771-A1B
1771-A2B
1771-A3B1
1771-A4B

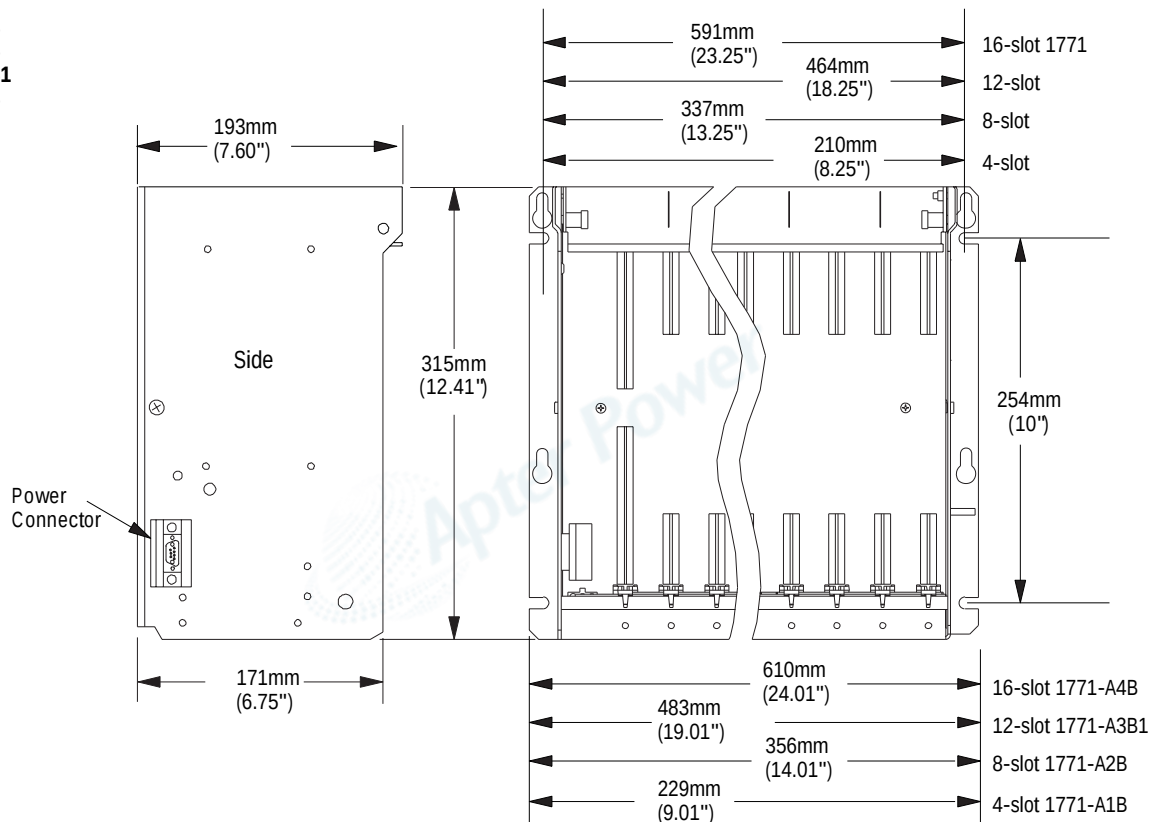


1771-A3B

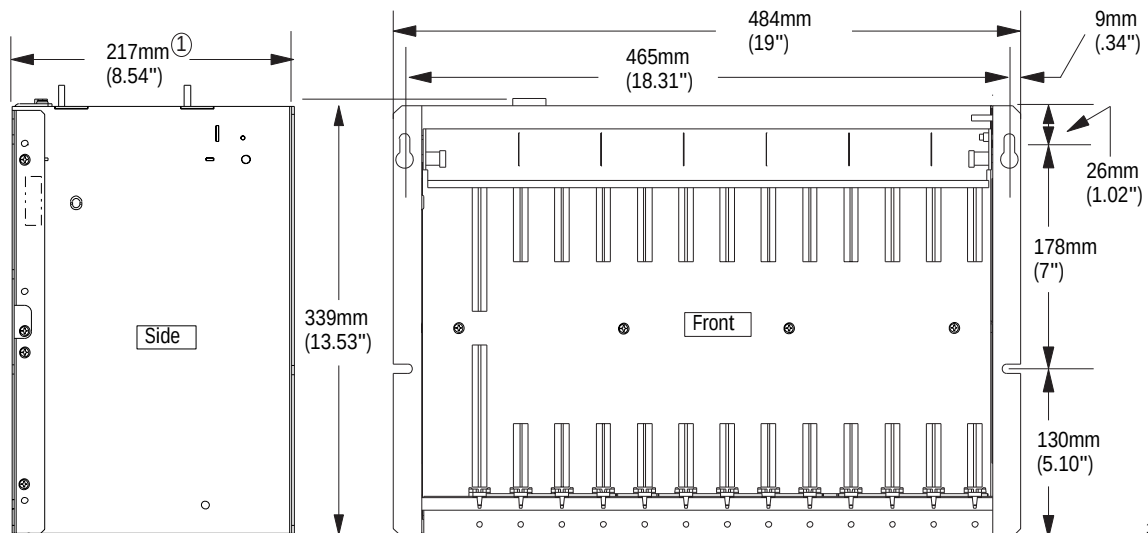

① Total maximum depth dimension per installation will be dependent upon module wiring and connectors.

12450-I

I/O Chassis and External Power Supply Dimensions

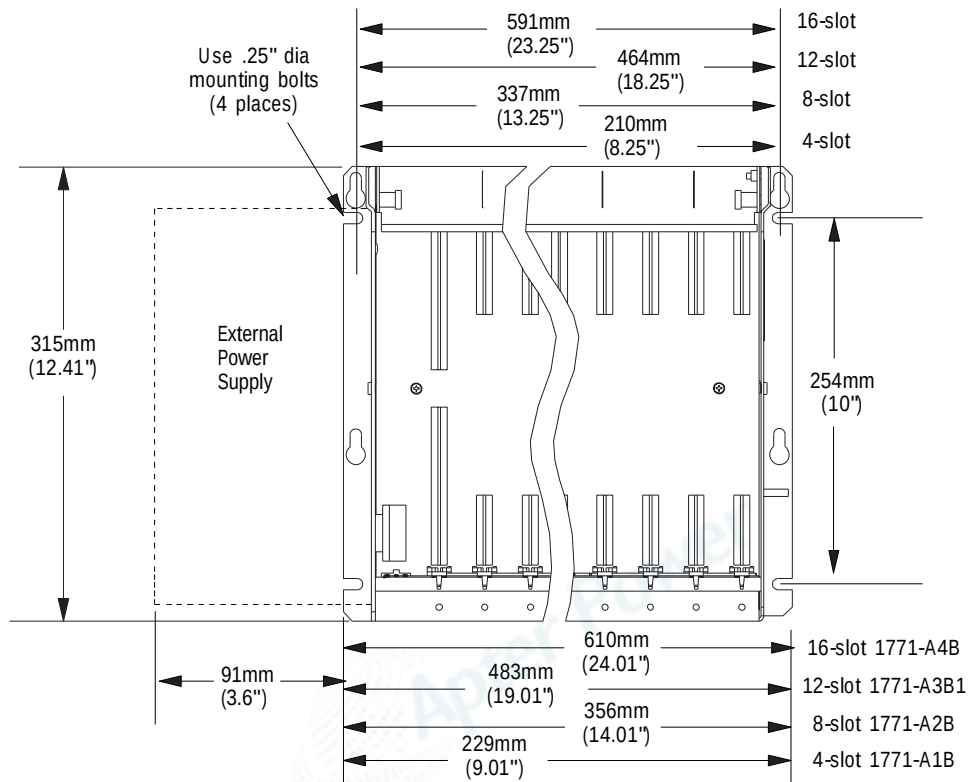

Clearance depth is 204mm (8") for 8 I/O connection points per module.

12451-I

Grounding Your System

For more information on proper grounding guidelines, see the Industrial Automation Wiring and Grounding Guidelines, publication 1770-4.1.